



INSTALLATION INSTRUCTIONS

1051YM

COMMERCIAL SERIES LINEAR FLOODLIGHT

IMPORTANT NOTE:

- Luminaire must be installed and grounded in accordance with the National Electrical Code (NEC) and local codes.
- Luminaire is UL listed for above grade installation only.
- Always use UL recognized wire connectors for connections.

MAINTENANCE: To assure proper operation and efficiency, lens must be kept clean and free of dirt, dust, leaves, trash and mineral deposits from water. A regular scheduled maintenance program is recommended.


SAFETY WARNING: Luminaire can become hot. Take care when locating luminaires.

NOTE: Save these instructions for future reference.



LUMINAIRE MOUNTING (YOKE) TO JUNCTION BOX(ES):

1. Make sure electrical supply is off at circuit breaker before starting luminaire installation or servicing luminaire.
2. Thread Luminaire Supply Conductor cable through the Cord Seal, the Yoke Mount Bushing through Yoke center hole and into Junction Box Lid. Tighten the Yoke Mount Bushing fully.
3. Route luminaire supply conductors into wet location rated J-Box (by others). Attach conduit supply conductors (by others) to the luminaire conductors observing polarity, line to black, neutral to white, and ground to green. Connect the supply / luminaire conductors using approved wiring methods.
4. Secure the Junction Box Lid onto the Junction Box using the Junction Box Lid Screws. Tighten.
5. Adjust the aim of the fixture and firmly re-tighten the Yoke Aiming Hex Nut(s) underneath the Yoke Decorative Caps.
6. Re-assemble the Decorative Caps onto the Yoke.
7. Tighten the Yoke Locking Set Screws to secure the aiming.
8. Supply power to the luminaire and check for proper operation.

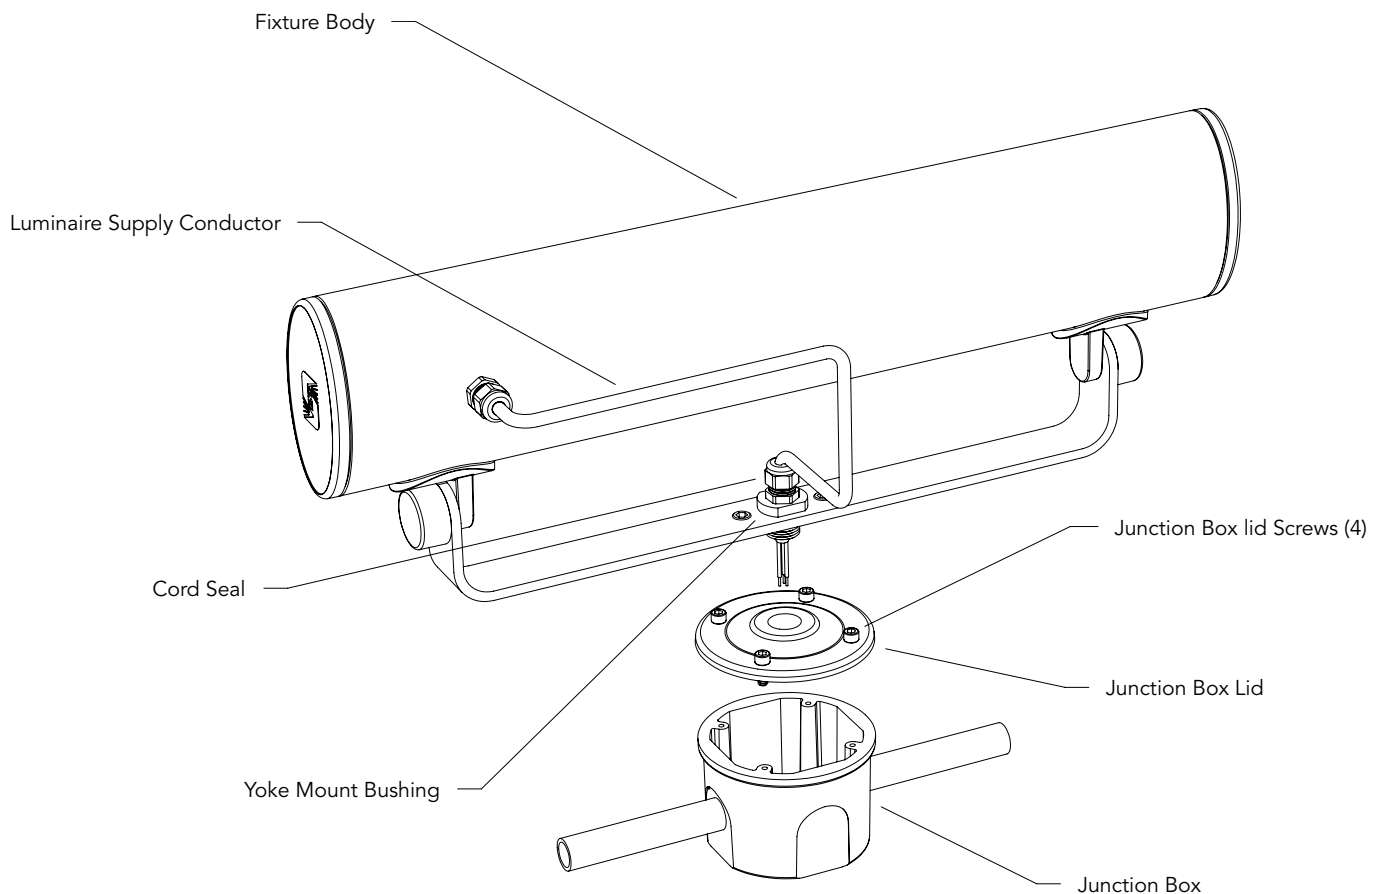

PROFESSIONAL
OUTDOOR LIGHTING

www.VistaPro.com · email@vistapro.com · Fax: (888) 670-VISTA (8478)

1625 Surveyor Avenue · Simi Valley, CA 93063 · (805) 527-0987 · (800) 766-VISTA (8478)

Vista Professional Outdoor Lighting reserves the right to modify the design and/or construction of fixtures shown in this document without further notification.

Page 1 of 1
REV 08.05.25